



SAMPLE NETWORK HEALTH MONITORING DECISION SUPPORT
REPORTS AVAILABLE FROM A VEGETATION FOCUSED LIDAR CAPTURE

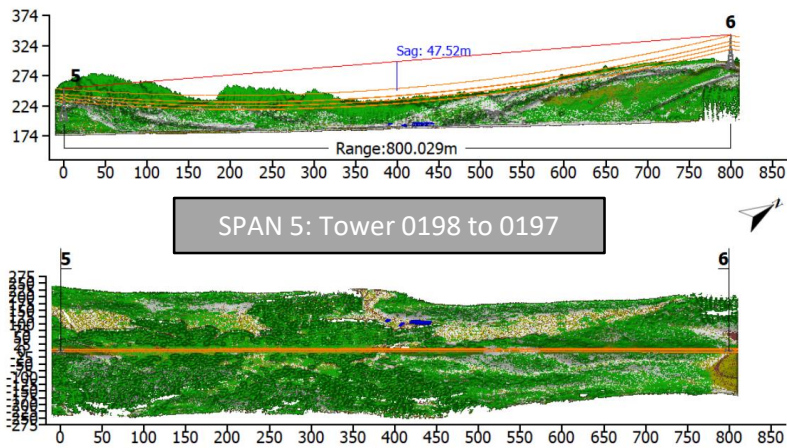


CROSS ARMS HEIGHT
DIFFERENCE REPORT

Tower Name	Arms Position	Arms Difference (m)	Arms Length (m)	Standard Value (m)	Qualified
0192	Up phase	0.007	11.202	0.022	Yes
	Middle phase	0.163	11.386	0.023	No
	Down phase	0.020	12.778	0.026	Yes

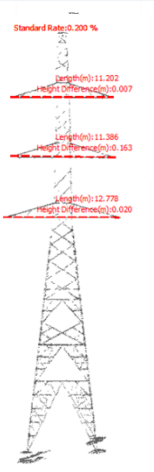


PROTECT ANGLE REPORT

Tower Name	Protect Angle	Phase
0192	35.5397	Right Phase Top
	21.0072	Right Phase Middle
	16.0797	Right Phase Bottom
	35.9626	Left Phase Top
	20.6536	Left Phase Middle
	16.2507	Left Phase Bottom





INSULATOR INCLINATION
REPORT

Tower Name	Insulator Inclination	Inclination Tan
0202	36.056	0.728
	-34.577	0.689
	35.523	0.714
	-32.964	0.649
	-34.994	0.700
	-31.737	0.618



INCLINATION
ANGLE REPORT

Tower Name		0190				NOT QUALIFIED	
Tilt Rate of Line Direction (%)	Tilt Rate of Vertical Line Direction (%)	Inclination (%)	Standard Value (%)	Tilt Direction of Line Direction	Tilt Direction of Vertical Line Direction		
0.58	0.58	0.82	0.30	AD	AB		

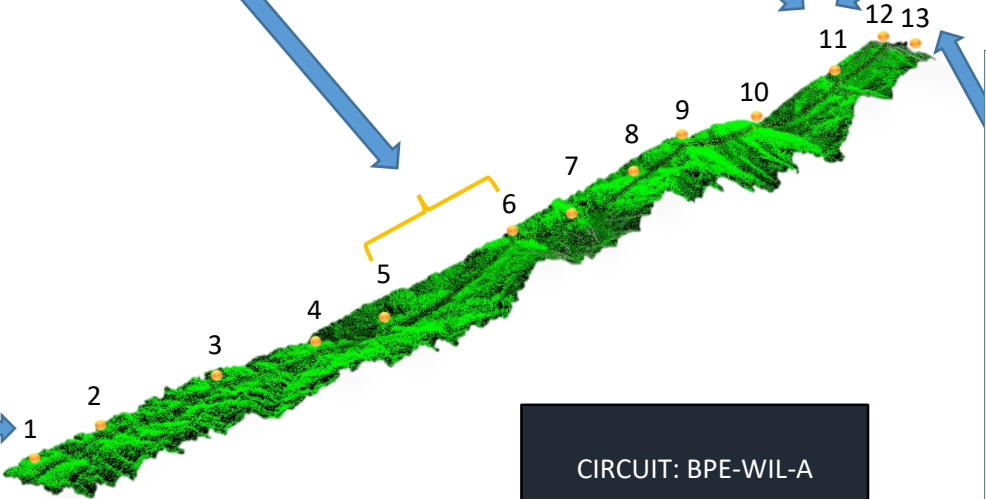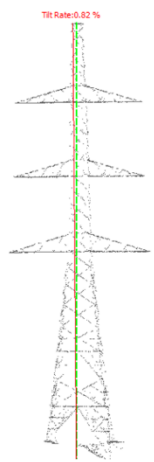

CIRCUIT: BPE-WIL-A